


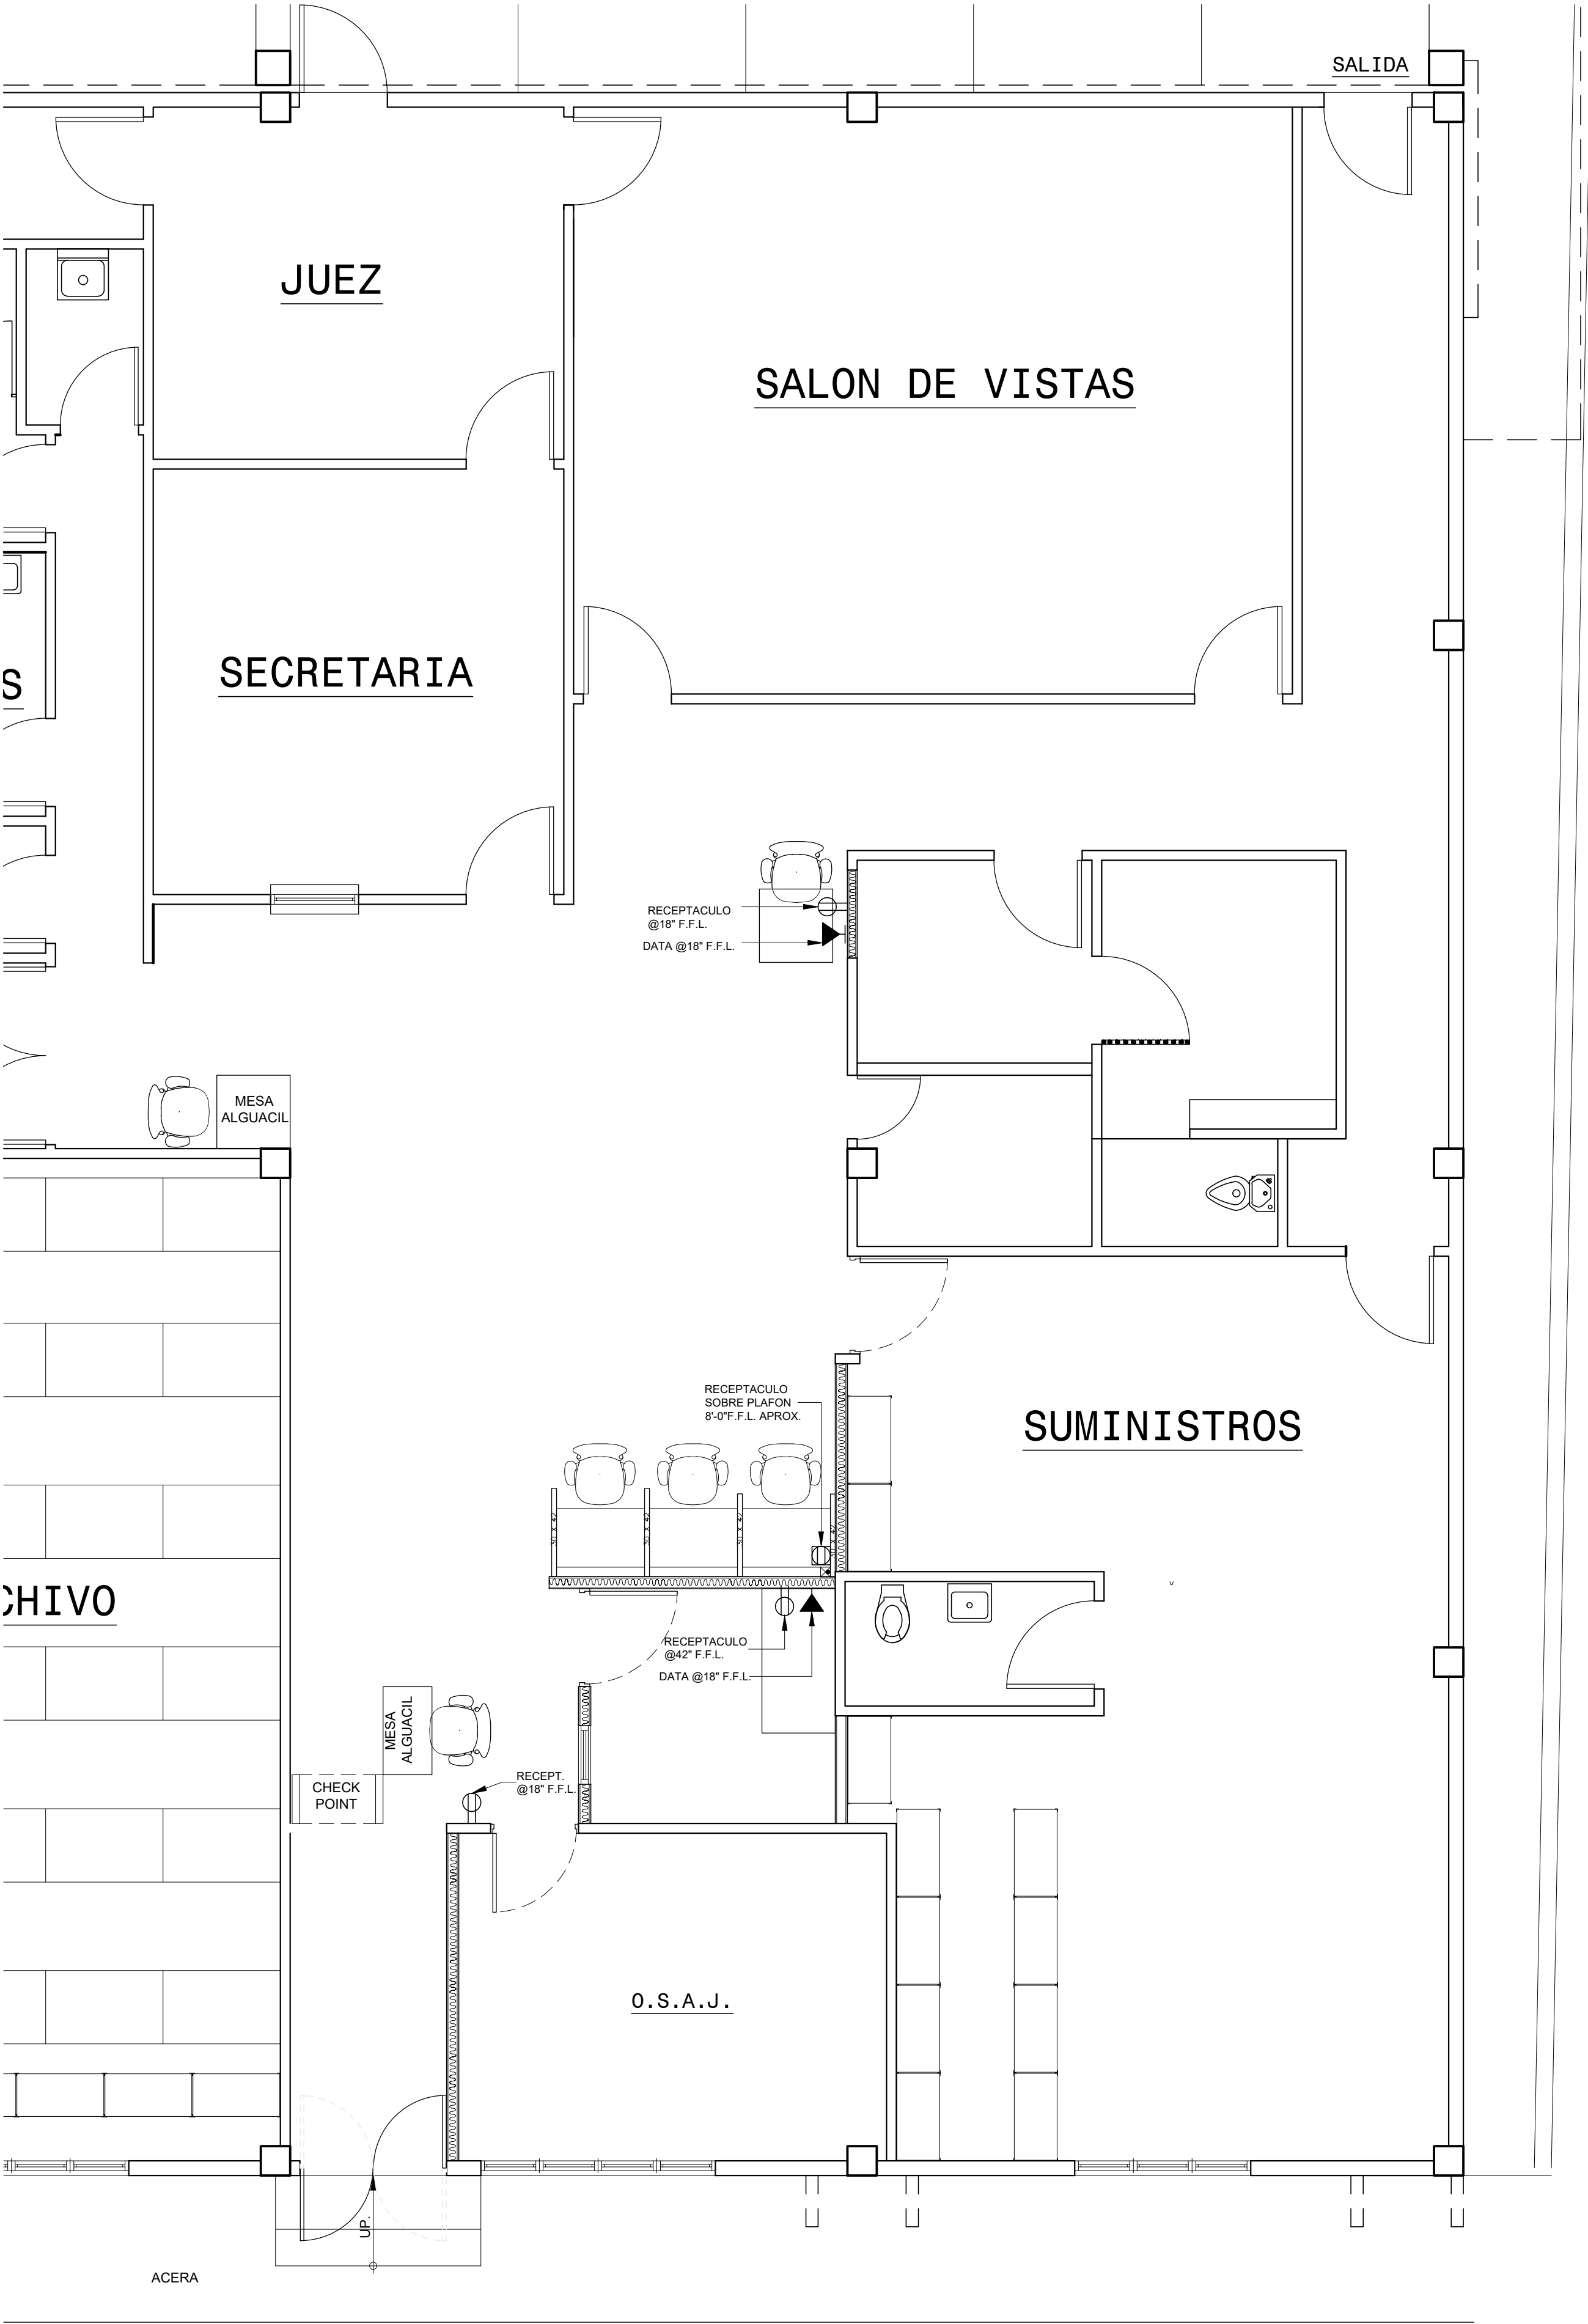

PLANTA ELECTRICA
SUMAC MUNICIPAL C/AIBONITO
SCALE: 1/4"=1'-0"

NOTES:

1. SHALL BE INSTALL NEW 120V CIRCUITS FROM EXISTING DISTRIBUTION PANEL , WITH 20AMP BREAKER PER CIRCUIT.
2. ALL RECEPTACLE AND COVER SHALL BE WHITE COLOR, 20AMP GFCI.
3. ALL NEW CIRCUITS SHALL BE IDENTIFIED IN THE ELECTRICAL PANEL LEGEND.
4. UNDER ANY CIRCUMSTANCE SHOULD BE REMOVED OR CONNECT AN ENERGIZED ELECTRICAL SYSTEM. ALL SOURCE OF POWER SHALL BE TURNED OFF AND LOCK OUT DURING WORKING TIME FRAME.
5. SHALL BE USE EMT TUBING, MINIMUM SIZE 3/4"Ø.
6. SHALL BE INSTALL AN 80KA, 120 /240V VOLT SURGE PROTECTION DEVICE TO THE EXISTING ELECTRIC PANEL, USING A 30AMP, 120 /240V TWO-POLE CIRCUIT BREAKER. SIMILAR OR EQUAL TO SQUARE D MODEL: HEPD80. ALL RELATED PARTS SHALL BE PROVIDED AND INSTALLED BY CONTRACTOR, AS MANUFACTURE INSTALLATION GUIDE.
7. CONTRACTOR SHALL BE USE CABLE THHN, STRANDED, #12 AWG FOR 20AMP CIRCUITS. AND SHALL BE USE CABLE THHN, STRANDED, #10 AWG FOR 30AMP CIRCUITS.

AT

R E V I S I O N S		
NO.	DESCRIPTION	DATE BY

TRIBUNAL GENERAL DE JUSTICIA
OFICINA DE ADMINISTRACION DE LOS TRIBUNALES
DIRECTORIA DE ADMINISTRACION
OFICINA DE ADMINISTRACION Y CONSERVACION DE LOCALES

APPROVED BY: _____ APPROVED SIGN: _____ APPROVED DATE: _____

PROJECT NAME:
DIGITALIZACION PLANOS DE INSTALACIONES DEL T.G.J.

PROJECT LOCATION:
CENTRO JUDICIAL DE AIBONITO, AIBONITO

DRAWING DESCRIPTIONS:
PLANTA ELECTRICA SUMAC MUNICIPAL

GERENTE DE PROYECTO:
ING. DANIEL PADILLA

CHECKED BY:
P.MORALES

FILE NAME:
0201-01-FIRST FLOOR AS-BUILT.dwg

PROJECT DATE:
12/MARZO/2025

DRAWING DATE:

DRAWING SCALE:
3/8"=1'-0"

SHEET NO.
F-01

OF: