


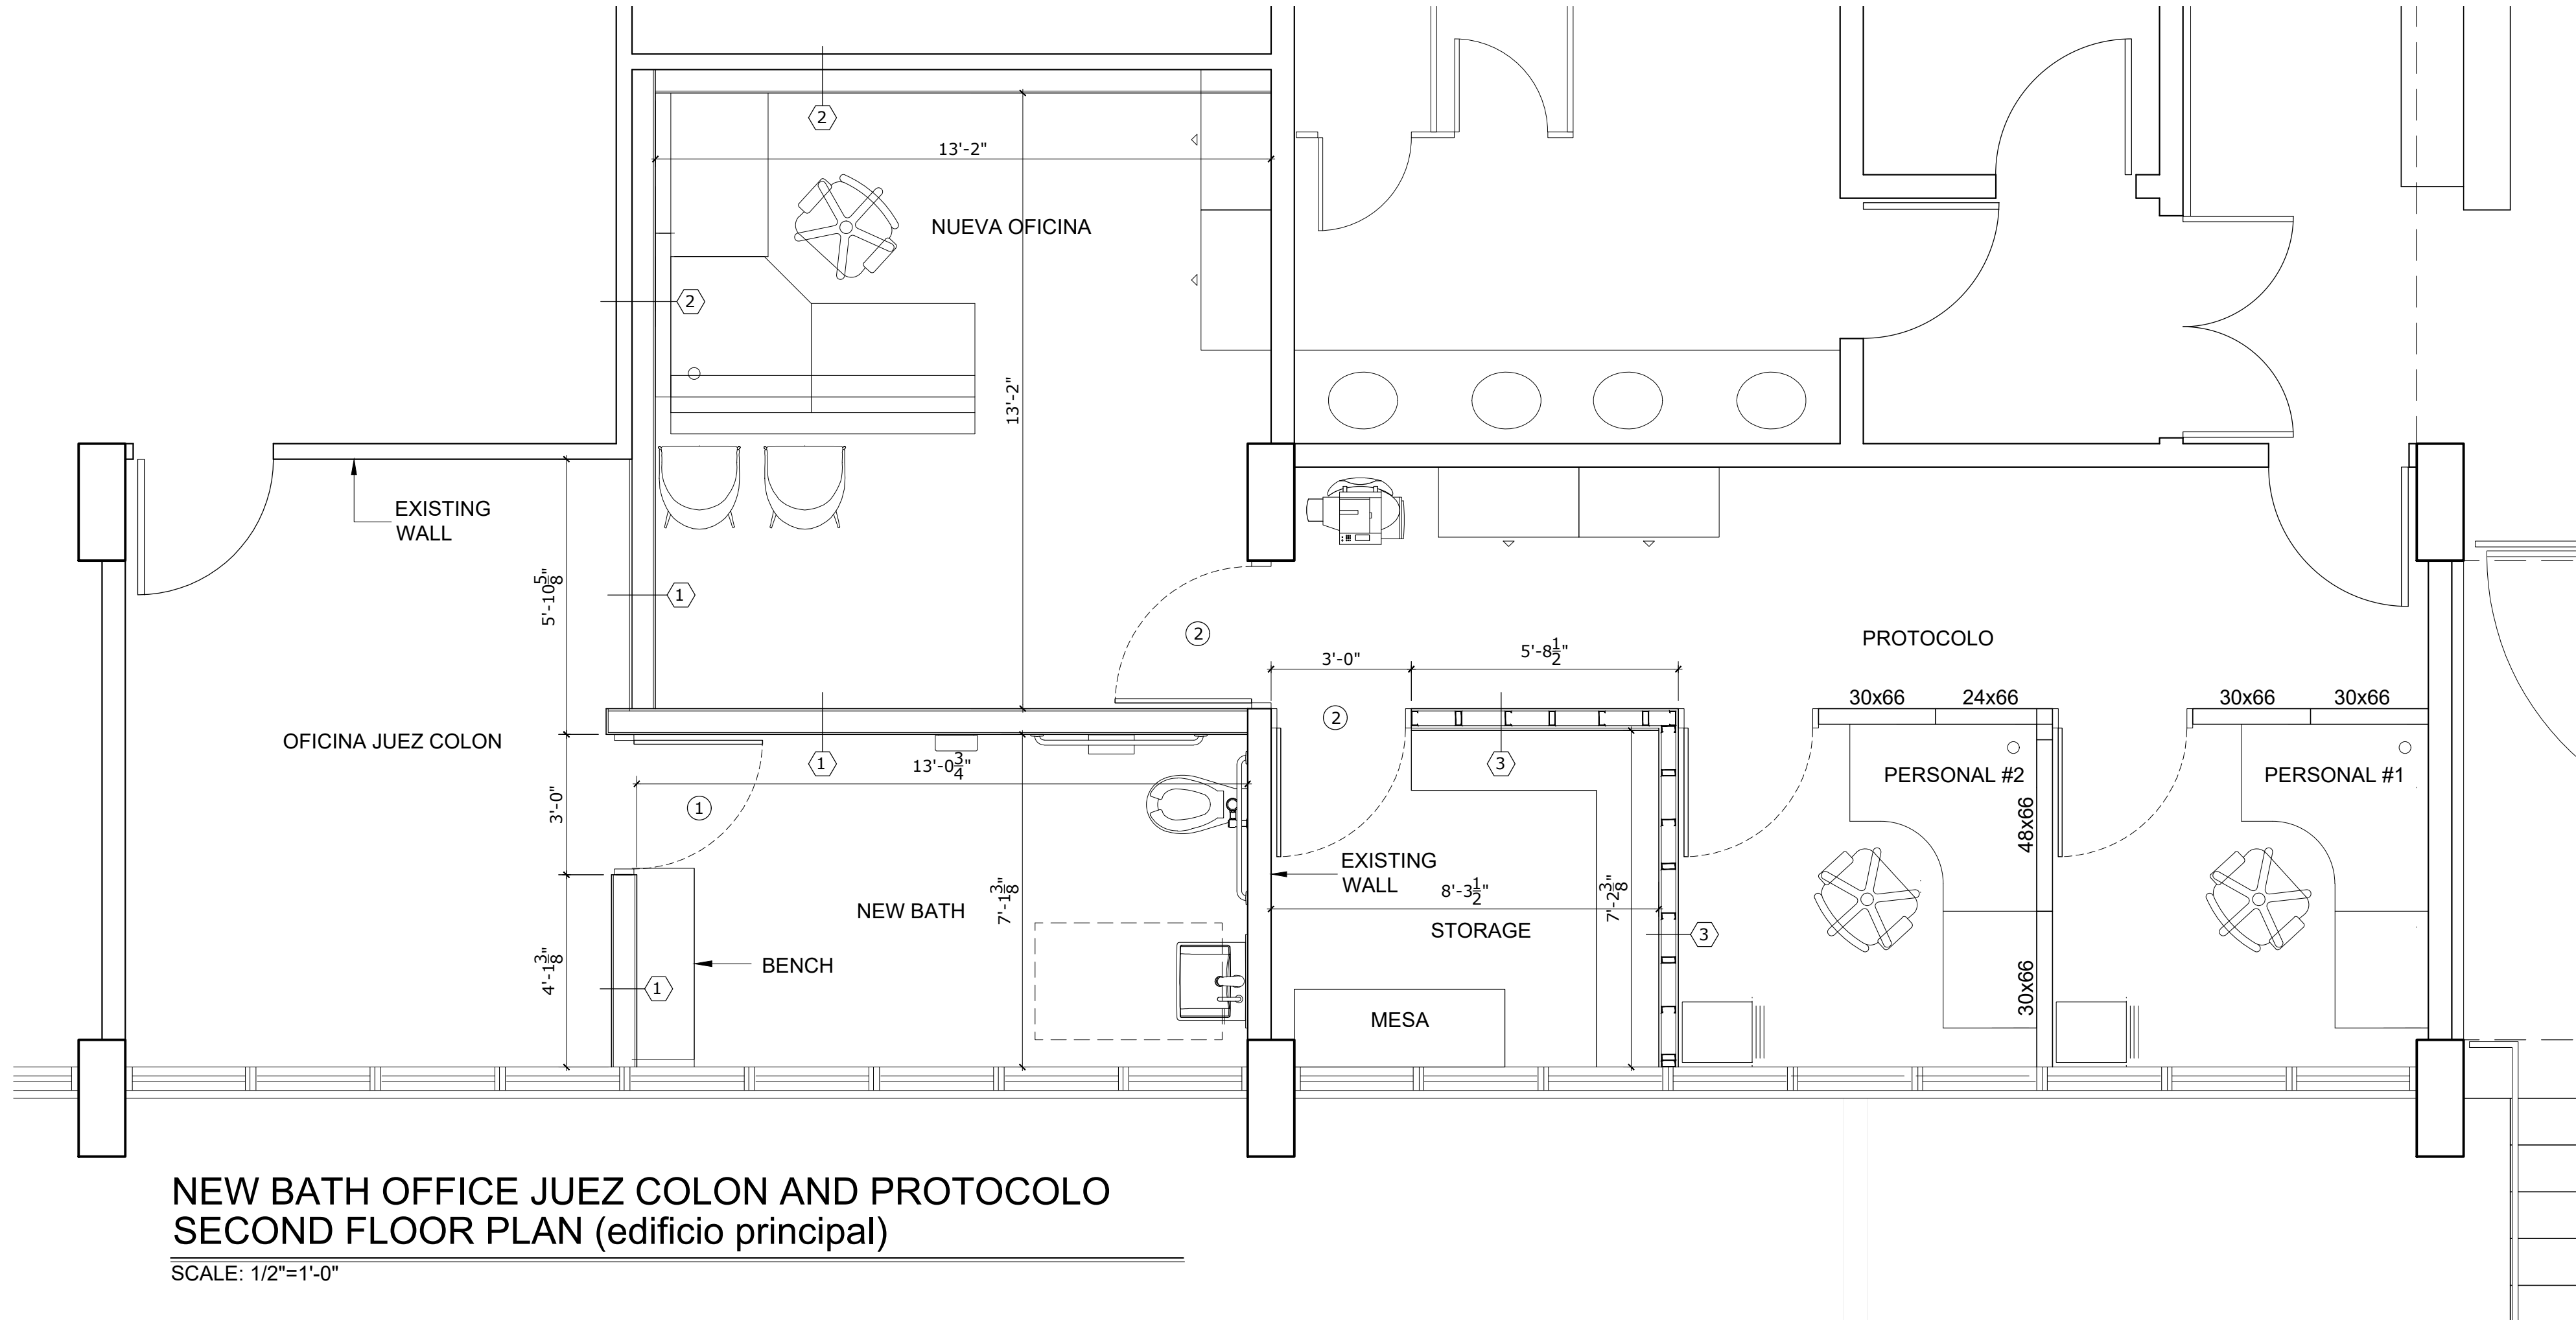

CONSTRUCTION NOTE:

- A) WALLS:
1. ALL DRYWALL SHALL BE GYPSUM BOARD WITH METAL STUDS FRAME,
 2. DRYWALLS SHALL BE TYPE "X" (1 HOUR FIRE RATING.)
 3. DRYWALL SHALL BE SOUND PROOF WITH INSULATION TYPE "R-19".
 4. THE DRYWALL PARTITIONS AT KITCHENETTE SHALL BE WATER RESISTANT.
 5. ALL DRY WALLS SHALL BE PAINTED WITH TWO (2) COAT OF ACRYLIC PAINT SEMI-GLOSS.
 6. ALL CONCRETE BLOCK WALLS SHALL BE PAINTED IN THE INSIDE OF PROJECT WITH SAME PAINT.
 7. ALL METAL STUDS SHALL BE 2 1/2" DEPTH, GA-20 AT 16" C.C. IF HEIGHT IS < FIELD DIMINTIONS.

- B) FLOOR:
1. FLOOR SHALL BE CLEAN AND POLISHED.
 2. INSTALL NEW TILES EQUAL OR SIMILAR OF EXISTING TILES INSTALLED AS REQUIRED IN AREA WHERE FLOOR OR WALL AS BE REMOVED.
 3. ALL NEW WALL SHALL BE WITH COVE BASES OF VINYL 4" (BLACK COLOR).
 4. THE DRYING TIME OF COVE ADHESIVE SHALL BE LESS THAN 48 HOURS.

- C) CEILING:
- * FOR CEILING SPECIFICATION NOTES, REFER DRAWING A-04, A-05 & A-06

- D) DOOR:
1. 1-3/4" SOLID CORE IMBUIA WOOD, (2)DOOR STOP AND (2)DOOR HANDLES.
 2. 1/4" CLEAR SAFETY GLASS VISION PANEL W/ WOOD MOLDING (AS TYPED).
 3. THREE (3) 4" STAINLESS STEEL HINGES BALL BARING PIVOT MOUNTED EACH DOOR.
 4. LOCKSET HARDWARE SHALL BE WITH LEVER, CYLINDRICAL LOCK KEY SYSTEM AND SATIN CHROME PLATED FINISHED.
 5. STANDARD STEEL DOOR FRAME GA 10 (MAX) OF 5" JAMB DEPTH, 1/2" BACK BEND, 2" FACE AND 1/2" STOP. ANCHOR TO WALL W/ 4" STEEL SCREW AT 2'-0" C.C. PAINTED SAME COLOR OF WALL AS BE ANCHORED.
 6. UNIVERSAL HARDWARE MEDIUM-DUTY DOOR'S CLOSER ARM, DOOR RANGING 44-188 lb.

IMPORTANT NOTE:

- * FOR WALL TYPES AND CONSTRUCTION DETAILS REFER DWG. A-07
- ALL OFFICE FURNITURE AND EQUIPMENT SHALL BE NOT INCLUDE IN THE GENERAL CONTRACT.
- THIS PLAN SHOWN THE BASIC OFFICE FURNITURE AND EQUIPMENTS FOR ELECTRICAL POWER LOCATION PROPOSAL ONLY.

FINISH SCHEDULE							
MKD	DESCRIPTION	SIZE	STYLE	COLOR	FINISH	MANUFACTURER	LOCATION
ACOUSTIC TILE							
AT-01	ACOSUTIC CEILING TILE	2'-0"X2'-0"X5/8"	CERRAMAGUARD FINE FISSURES 607	WHITE	PRELUDE XL 15/16" FIRE GUARD	ARMSTRONG	ALL RESTROOMS
CERAMIC TILE							
CT-01	CERAMIC TILE (FLOOR)	12" X 24"	NEOCONCRETE COLORBODY PORCELAIN	LIGHT GRAY NE12 & COVE BASE 6" X 12" P-36C9TB	LIGHT POLISHED	DAL TILE	
CT-02	CERAMIC TILE (WALL)	12" X 24"	COHESION COLORBODY PORCELAIN	BEIGE CO22	POLISHED		
NOTES: 1. FLOOR TILE MIN. GROUT JOINT RECOMMENDATION: 1/8". 2. ADDITIONAL GROUT RECOMMENDATIONS: FLOOR – 3/16" WHEN MULTIPLE SIZES ARE INSTALLED IN A MODULAR PATTERN AND/OR WHEN TILE WITH A LENGHT 15" O GRATER IS INSTALLED IN A STAGGERED BRICK-JOINT PATTERN. OVERLAP SHOULD NOT EXCEED 33% 3. DCOF WET & LEVEL INTERIOR ≥ .42 / EXTERIOR FLOOR APPLICATIONS ≥ .60 / RAMPS & INCLINES ≥ .65. 2. FOR CT-01 PROVIDE 6"X12" COVE BASE P-36C9TB. GENERAL CONCTRACTOR MUST SUBMIT TILE SAMPLE FOR ARCHITECT APPROVAL PRIOR TO ORDERING.							

AT

R E V I S I O N S			
NO.	DESCRIPTION	DATE	BY

TRIBUNAL GENERAL DE JUSTICIA

OFICINA DE ADMINISTRACION DE LOS TRIBUNALES

DIRECTORIA DE ADMINISTRACION

OFICINA DE ADMINISTRACION Y CONSERVACION DE LOCALES

APPROVED BY:

APPROVED SIGN: _____

APPROVED DATE: _____

PROJECT NAME:

DIGITALIZACION PLANOS RAMA JUDICIAL(Actualizacion 5-10-10)

PROJECT LOCATION:

TRIBUNAL SUPREMO

DRAWING DESCRIPTION:

PLANTA PROPIUESTA

SHEET NO.:

A-01

CHECKED BY:

P.MORALES

DRAWING BY:

1601-A-SECOND.dwg

FILE NAME:

DATE:

21-ENERO-2025

SCALE:

1/8"=1'-0"