


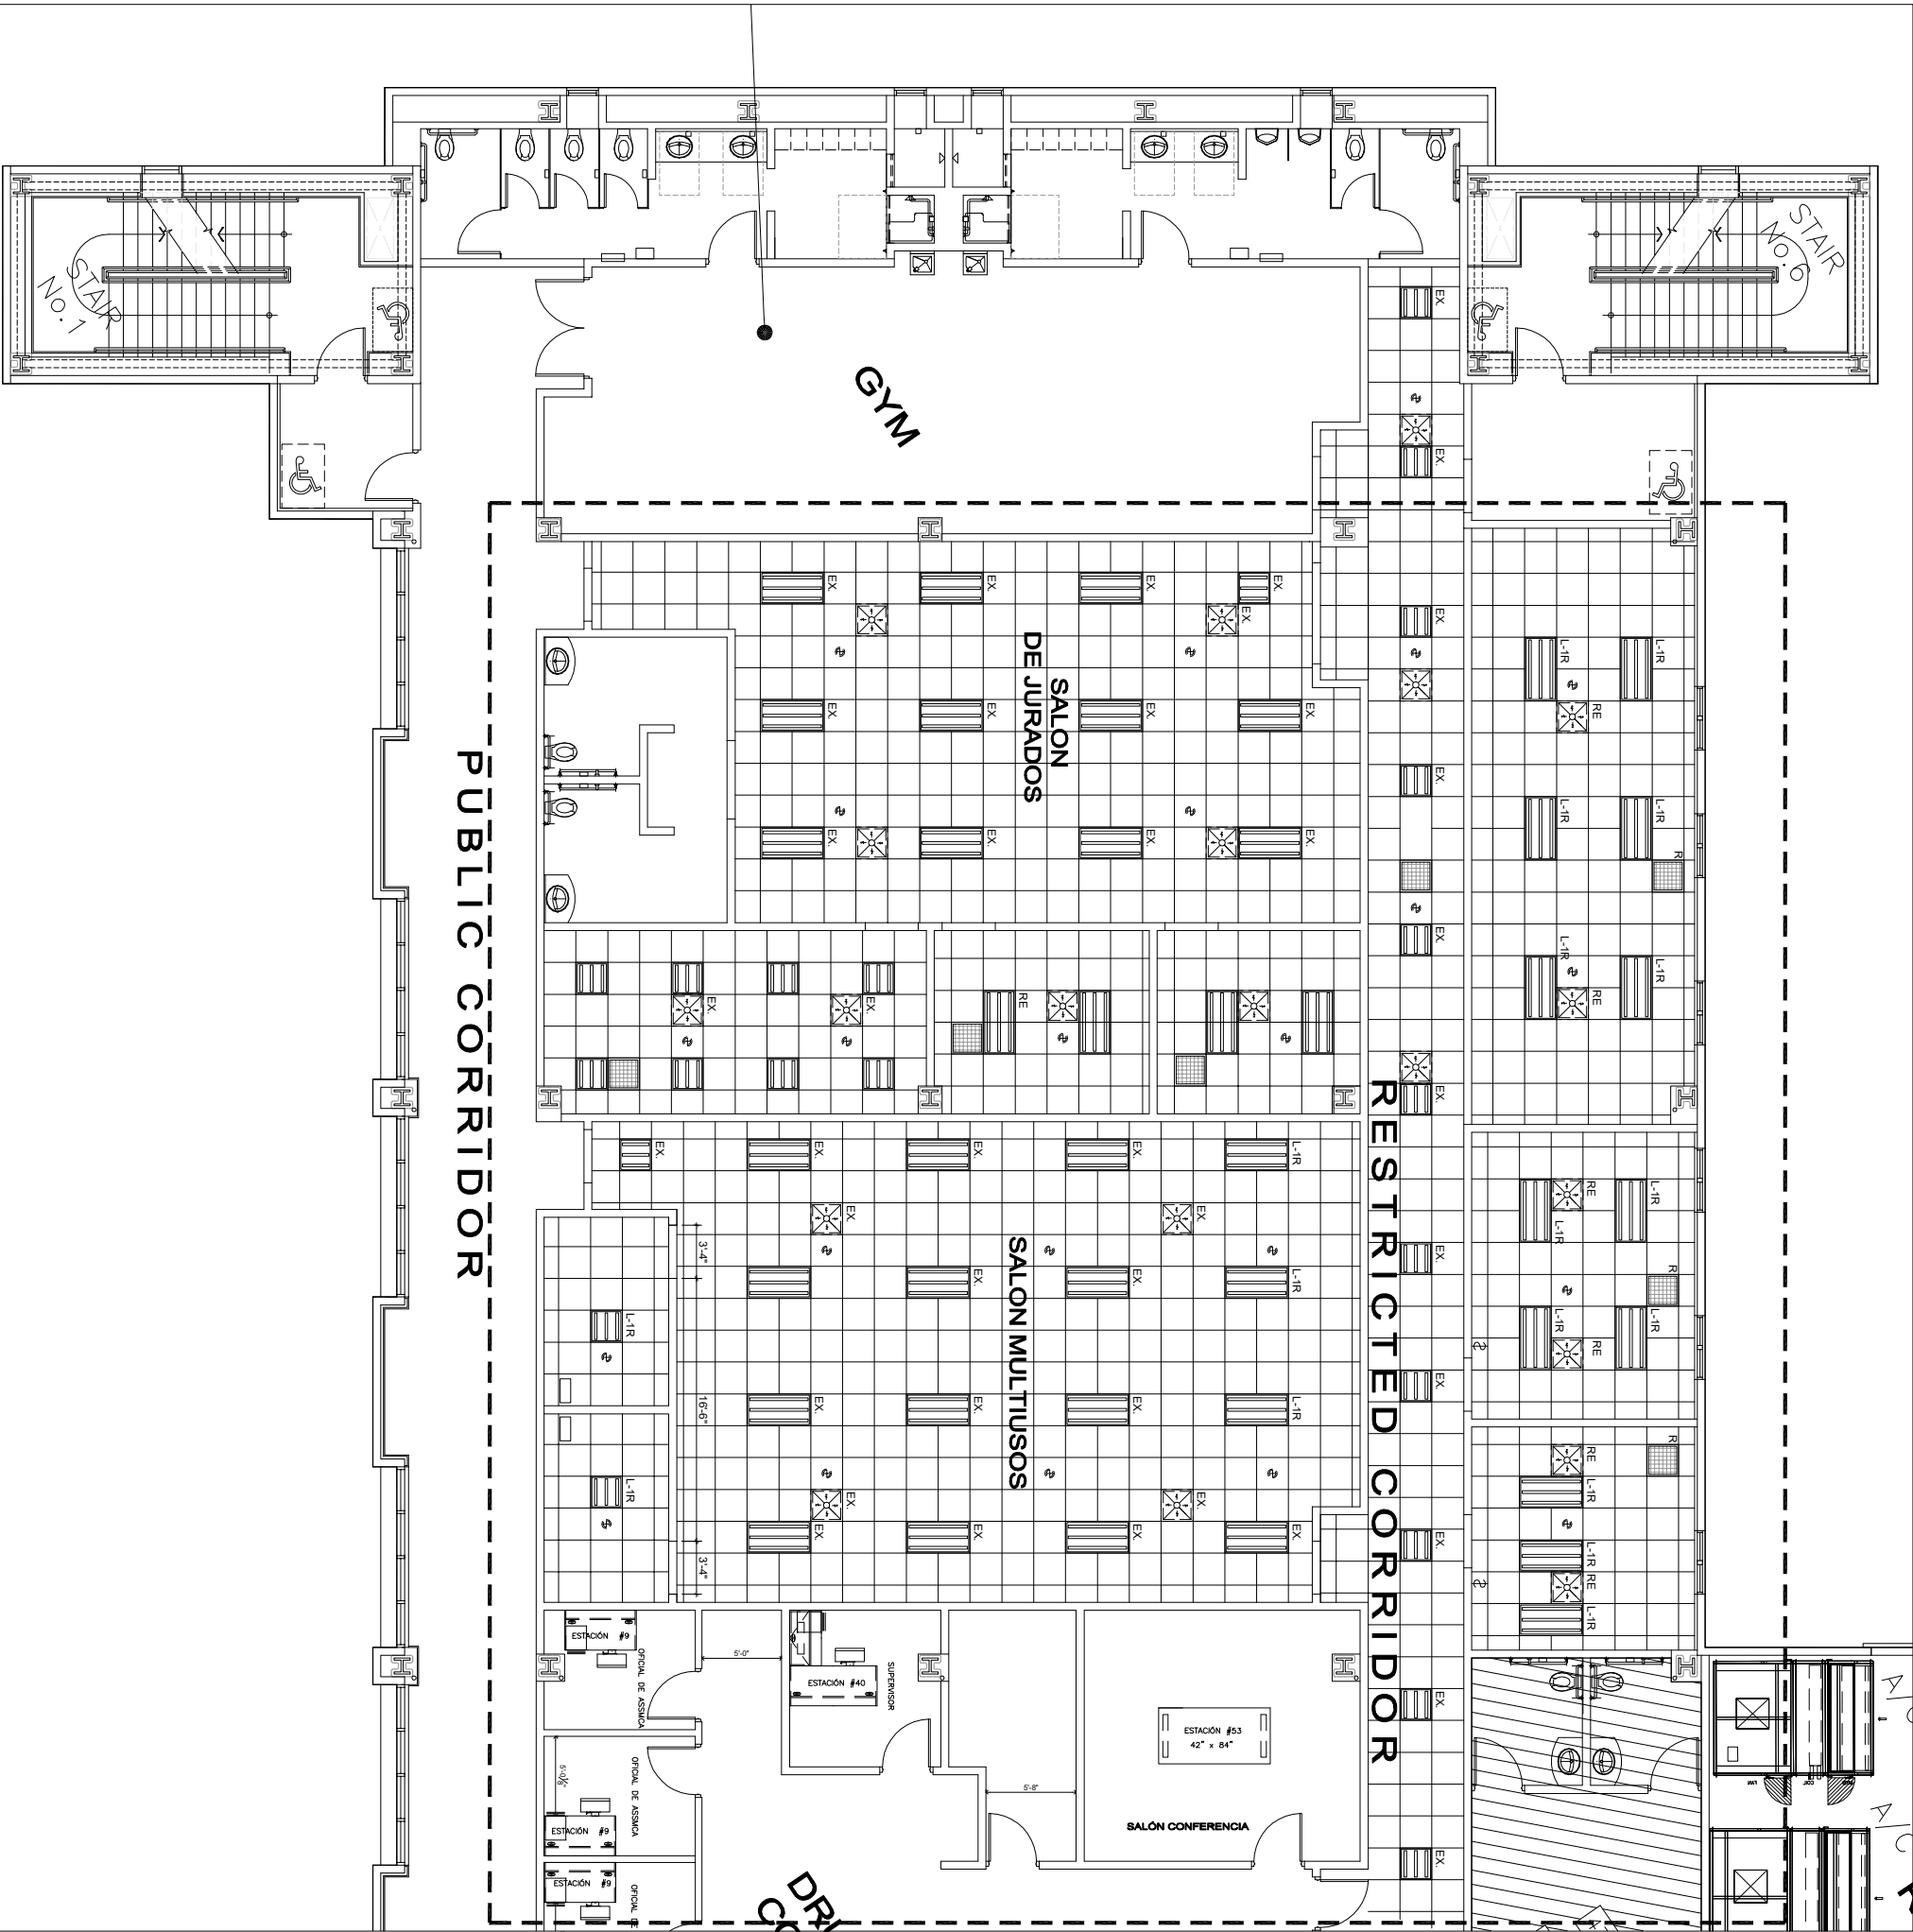

LEGEND:

2'-0"x2'-0" EXISTING ACOUSTICAL HUNG CEILING

2'-0"x4'-0" EXISTING LIGHTING FIXTURE TO BE RELOCATED. SEE ELECTRICAL DRAWING SHEET A-2.1.

2'-0"x4'-0" EXISTING LIGHTING FIXTURE NEW POSITION RELOCATION.

2'-0"x4'-0" EXISTING LIGHTING FIXTURE TO REMAIN. SEE ELECTRICAL DRAWING.

2'-0"x7'-0" NEW FLAT PANEL LED LIGHTING FIXTURE TO BE INSTALLED.

NEW LIGHTING CIRCUIT. SHALL BE USED #12 AWG IN 3/4" EMT
NEW TWO LED - WHITE EXIT LIGHT FIXTURE WITH BATTERY BACKUP OF 60 MINUTES RUN TIME OR MORE RATED UL 924 UL DAMP LOCATION AND NFPA 101, 120/277V, TO BE INSTALLED & CONNECTED TO THE NEAREST LIGHTING CIRCUIT. BELOW THE CEILING.

-EXISTING A/C 2x2x2 RETURN TO REMAIN.

-NEW A/C 2x2x2 RETURN TO BE INSTALLED.

-EXISTING A/C 2x2x2 RETURN TO BE REMOVED.

-EXISTING A/C 2x2x2 SUPPLY TO REMAIN.

-NEW A/C 2x2x2 SUPPLY TO BE INSTALLED. INSTALLATION SHALL BE MADE USING A FLEXIBLE HOSE BETWEEN DIFFUSER AND AIR SUPPLY DUCT.

-EXISTING A/C 2x2x2 SUPPLY TO BE RELOCATED. RELOCATION SHALL BE MADE USING A FLEXIBLE HOSE BETWEEN DIFFUSER AND AIR SUPPLY DUCT.

-EXISTING SPRINKLER

EXISTING EMERGENCY LIGHT TO REMAIN.

NEW TWO LED - WHITE EMERGENCY LIGHT FIXTURE WITH BATTERY BACKUP OF 60 MINUTES RUN TIME OR MORE RATED UL 924 UL DAMP LOCATION AND NFPA 101, 120/277V, TO BE INSTALLED & CONNECTED TO THE NEAREST LIGHTING CIRCUIT. BELOW THE CEILING.

NEW 20 AMP, THREE WAY WHITE COMMERCIAL GRADE SWITCH, TO BE INSTALLED @ 4' A.F.F.

NEW 20 AMP, SINGLE WHITE COMMERCIAL GRADE SWITCH, TO BE INSTALLED @ 4' A.F.F. NUMBER INDICATES LUMINARIES TO BE CONTROLLED.

EXISTING SINGLE SWITCH TO BE REPLACE WITH NEW 20AMP WHITE COMMERCIAL GRADE SWITCH LIGHTING CONTROL CIRCUIT SHALL BE REUSED NUMBER INDICATES LUMINARIES TO BE CONTROLLED.

NOTES:

1. SHALL BE USE EMT TUBING. MINIMUM SIZE 3/4"Ø.
2. ALL SWITCHES AND COVER SHALL BE WHITE COLOR.
3. ALL LIGHTING CIRCUITS SHALL BE CONNECTED TO AN EXISTING LIGHTING CIRCUITS.
4. UNDER ANY CIRCUMSTANCE SHOULD BE REMOVED OR CONNECT AN ENERGIZED ELECTRICAL SYSTEM. ALL SOURCE OF POWER SHALL BE TURNED OFF AND LOCK OUT DURING WORKING TIME FRAME.

PROJECT NAME:
CENTRO JUDICIAL CAGUAS

PROJECT LOCATION:
4 to. PISO DEL CENTRO JUDICIAL DE CAGUAS

DRAWING DESCRIPTIONS:
PLANTA DE TECHO REFLEJADO EXISTENTE

SHEET NO.:
A-2.0

OF:
09

ESPEC. EN ADMINIST.
OSCAR HERNANDEZ
CHECKED BY:
DANIEL PADILLA
DRAWING BY:
P.MORALES
FILE NAME:

GERENTE DE PROYECTO:
PROJECT DATE:
PRINTING DATE:
DRAWING SCALE:

FEBRERO-2024
1/4"=1'-0"

TRIBUNAL GENERAL DE JUSTICIA
OFICINA DE ADMINISTRACION DE LOS TRIBUNALES
DIRECTORIA DE ADMINISTRACION
OFICINA DE ADMINISTRACION Y CONSERVACION DE LOCALES

APPROVED BY:

APPROVED SIGN:

APPROVED DATE:

REVISIONS

NO.	DESCRIPTION	DATE	BY

