


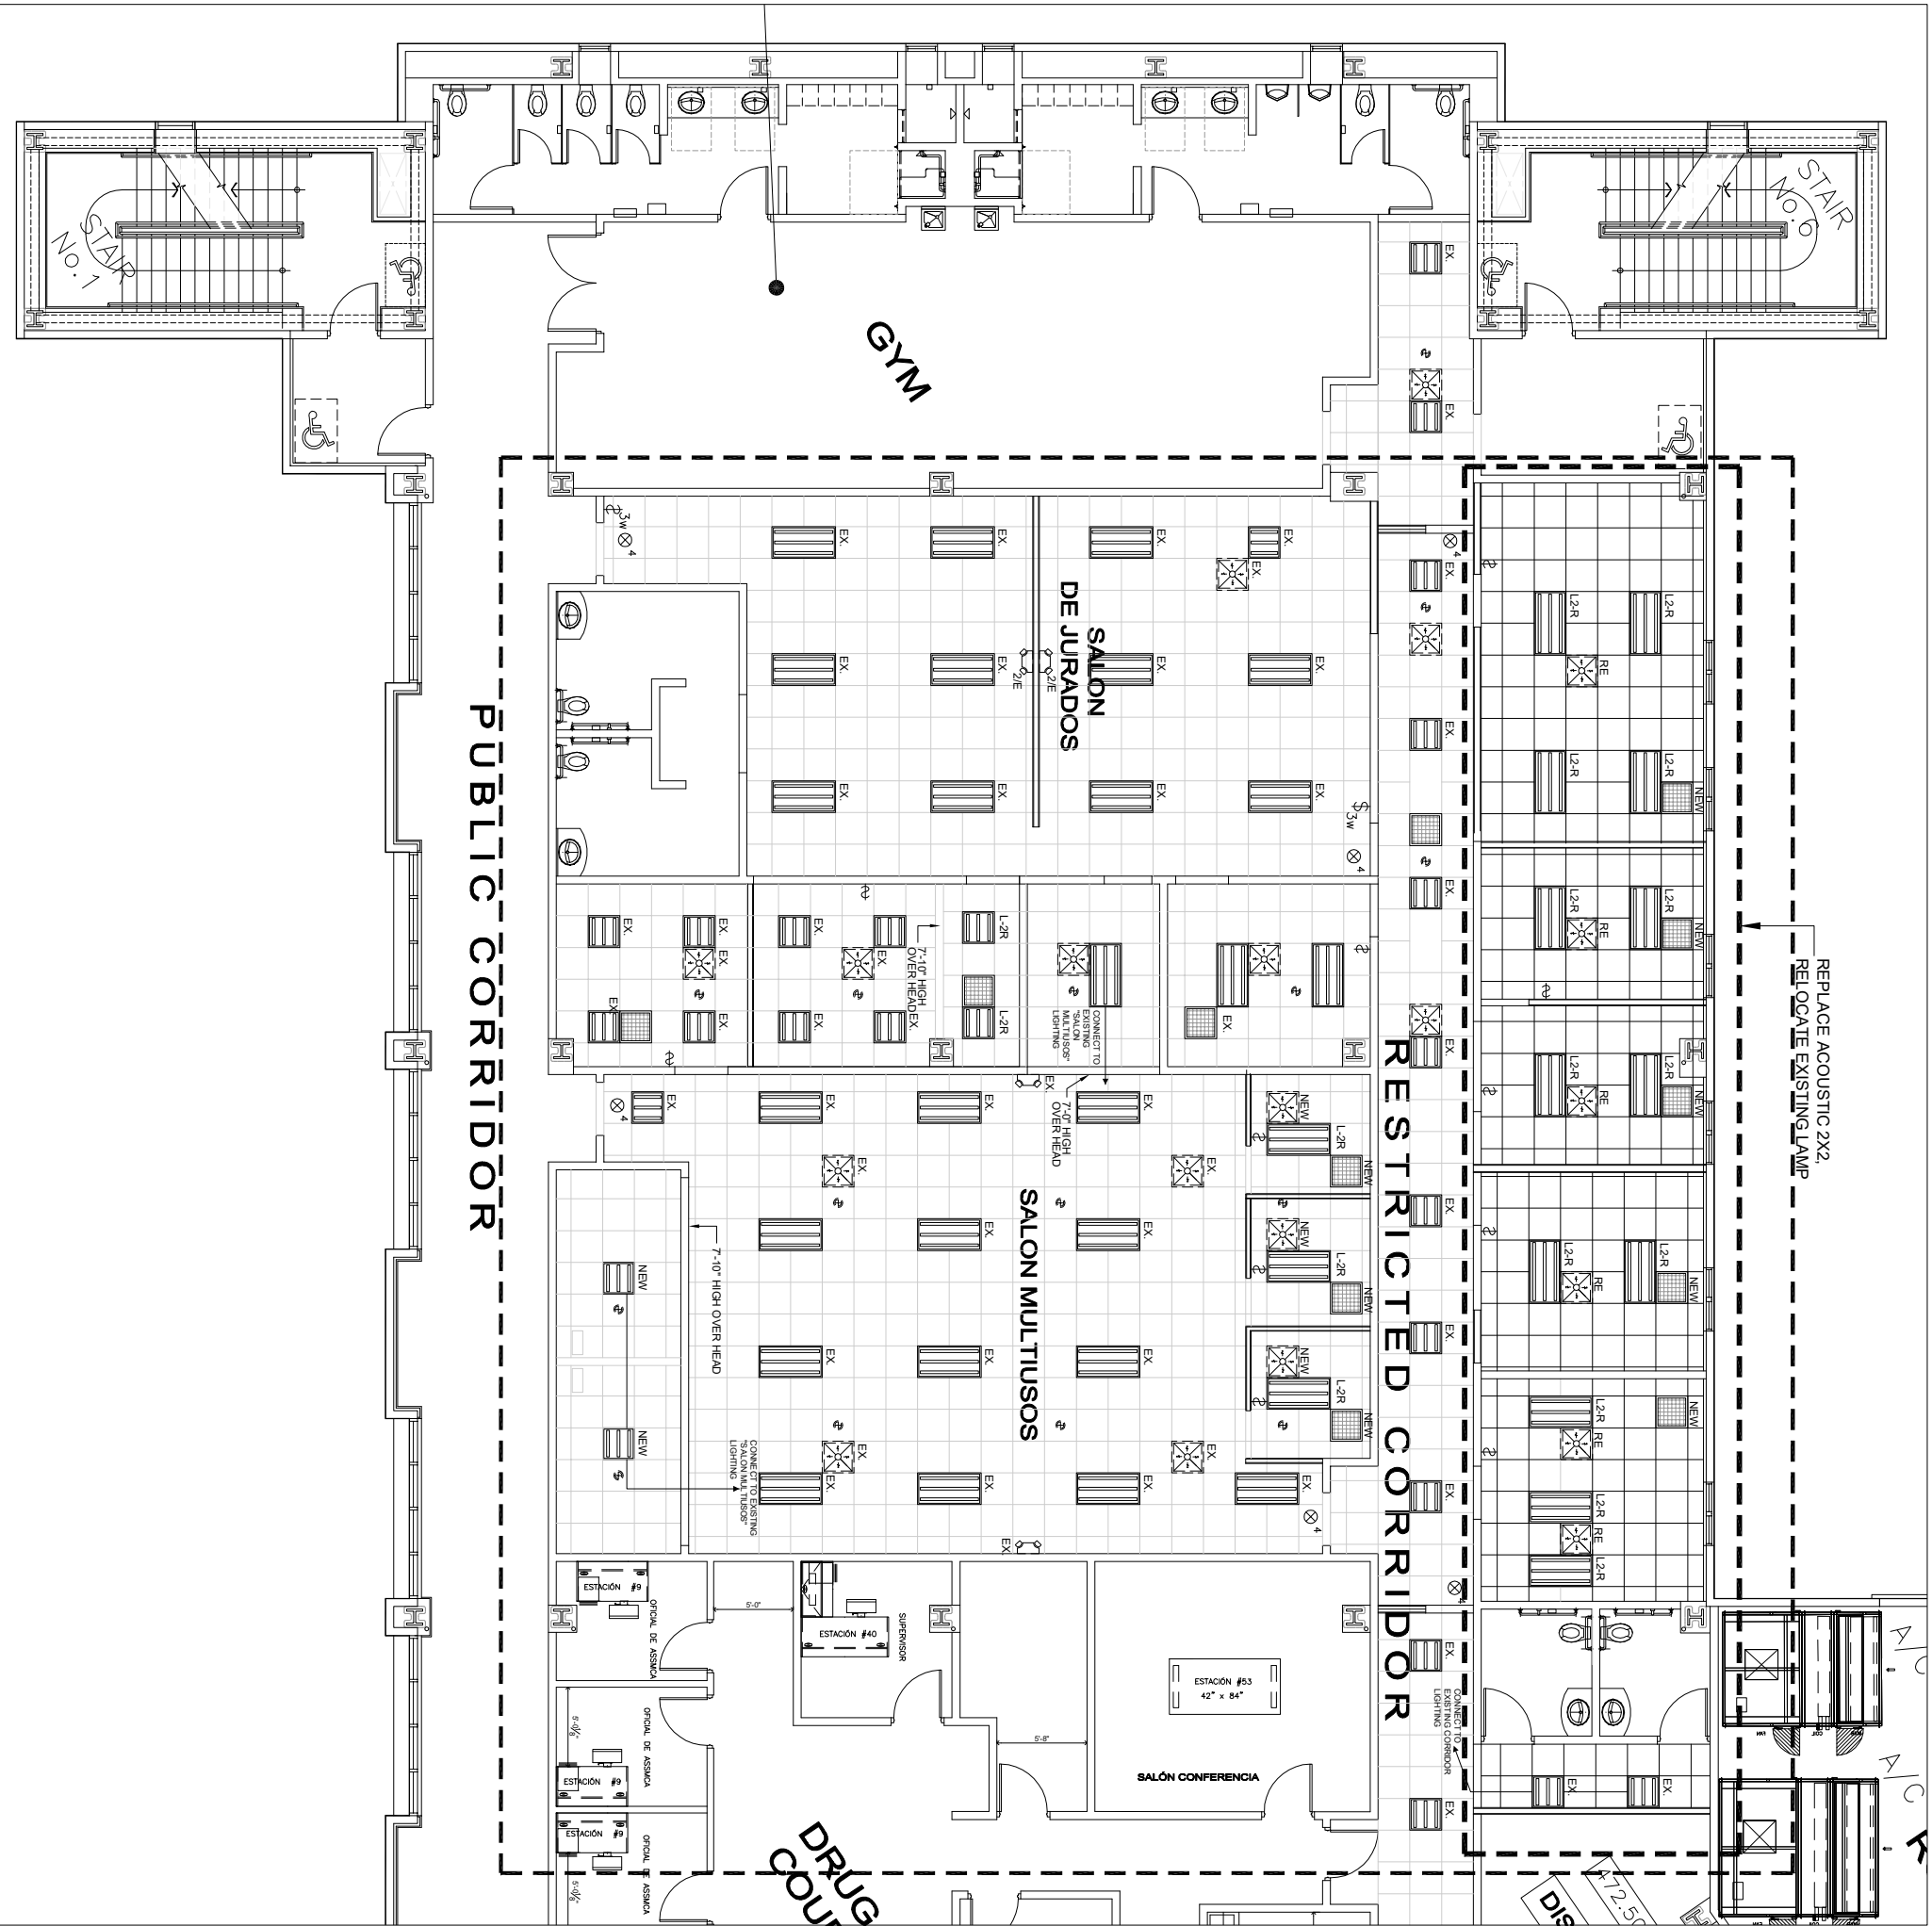

LEGEND:

2'-0" x 2'-0" EXISTING ACOUSTICAL HUNG CEILING

2'-0" x 4'-0" EXISTING LIGHTING FIXTURE TO BE RELOCATED. SEE ELECTRICAL DRAWING SHEET A-2.1.

2'-0" x 4'-0" EXISTING LIGHTING FIXTURE NEW POSITION RELOCATION.

2'-0" x 4'-0" EXISTING LIGHTING FIXTURE TO REMAIN. SEE ELECTRICAL DRAWING.

2'-0" x 2'-0" NEW FLAT PANEL LED LIGHTING FIXTURE TO BE INSTALLED

NEW LIGHTING CIRCUIT. SHALL BE USED #12 AWG IN 3/4" EMT

NEW TWO LED - WHITE EXIT LIGHT FIXTURE. WITH BATTERY BACKUP OF 60 MINUTES RUN TIME OR MORE. RATED UL 924 UL DAMP LOCATION AND NFPA 101, 120/277V. TO BE INSTALLED & CONNECTED TO THE NEAREST LIGHTING CIRCUIT. BELOW THE CEILING.

-EXISTING AC 2x2 RETURN TO REMAIN.

-NEW AC 2x2 RETURN TO BE INSTALLED.

-EXISTING AC 2x2 RETURN TO BE REMOVED

-EXISTING AC 2x2 SUPPLY TO REMAIN.

-NEW AC 2x2 SUPPLY TO BE INSTALLED. INSTALLATION SHALL BE MADE USING A FLEXIBLE HOSE BETWEEN DIFFUSER AND AIR SUPPLY DUCT.

-EXISTING AC 2x2 SUPPLY TO BE RELOCATED. RELOCATION SHALL BE MADE USING A FLEXIBLE HOSE BETWEEN DIFFUSER AND AIR SUPPLY DUCT.

-EXISTING SPRINKLER

EXISTING EMERGENCY LIGHT TO REMAIN.

NEW TWO LED - WHITE EMERGENCY LIGHT FIXTURE. WITH BATTERY BACKUP OF 60 MINUTES RUN TIME OR MORE. RATED UL 924 UL DAMP LOCATION AND NFPA 101, 120/277V. TO BE INSTALLED & CONNECTED TO THE NEAREST LIGHTING CIRCUIT. BELOW THE CEILING.

NEW TWO LED - WHITE EMERGENCY LIGHT FIXTURE. WITH BATTERY BACKUP OF 60 MINUTES RUN TIME OR MORE. RATED UL 924 UL DAMP LOCATION AND NFPA 101, 120/277V. TO BE INSTALLED & CONNECTED TO THE NEAREST LIGHTING CIRCUIT. BELOW THE CEILING.

EXISTING EMERGENCY LIGHT TO REMAIN.

NEW 20 AMP, THREE WAY WHITE COMMERCIAL GRADE SWITCH. TO BE INSTALLED @ 4" A.F.F.

NEW 20 AMP, SINGLE WHITE COMMERCIAL GRADE SWITCH. TO BE INSTALLED @ 4" A.F.F.

EXISTING SINGLE SWITCH TO BE REPLACE. WITH NEW 20AMP WHITE COMMERCIAL GRADE SWITCH. LIGHTING CONTROL CIRCUIT SHALL BE REUSED. NUMBER INDICATES LUMINAIRES TO BE CONTROLLED.

NOTES:

- SHALL BE USE EMT TUBING. MINIMUM SIZE 3/4".
- ALL SWITCHES AND COVER SHALL BE WHITE COLOR.
- ALL LIGHTING CIRCUITS SHALL BE CONNECTED TO AN EXISTING LIGHTING CIRCUITS.
- UNDER ANY CIRCUMSTANCE SHOULD BE REMOVED OR CONNECT AN ENERGIZED ELECTRICAL SYSTEM. ALL SOURCE OF POWER SHALL BE TURNED OFF AND LOCK OUT DURING WORKING TIME FRAME.

PROJECT NAME:
CENTRO JUDICIAL CAGUAS

PROJECT LOCATION:
4 to. PISO DEL CENTRO JUDICIAL DE CAGUAS

DRAWING DESCRIPTIONS:
PLANTA DE TECHO REFLEJADO PROPUESTO

A-2.1

09

ESPEC. EN ADMINIST.
OSCAR HERNANDEZ

CHECKED BY:
DANIEL PADILLA

DRAWING BY:
P.MORALES

FILE NAME:

GERENTE DE PROYECTO:

PROJECT DATE:

PRINTING DATE:
FEBRERO-2024

DRAWING SCALE:
1/4"=1'-0"

TRIBUNAL GENERAL DE JUSTICIA
OFICINA DE ADMINISTRACION DE LOS TRIBUNALES
DIRECTORIA DE ADMINISTRACION
OFICINA DE ADMINISTRACION Y CONSERVACION DE LOCALES

APPROVED BY:

APPROVED SIGN:

APPROVED DATE:

R E V I S I O N S			
NO.	DESCRIPTION	DATE	BY

