



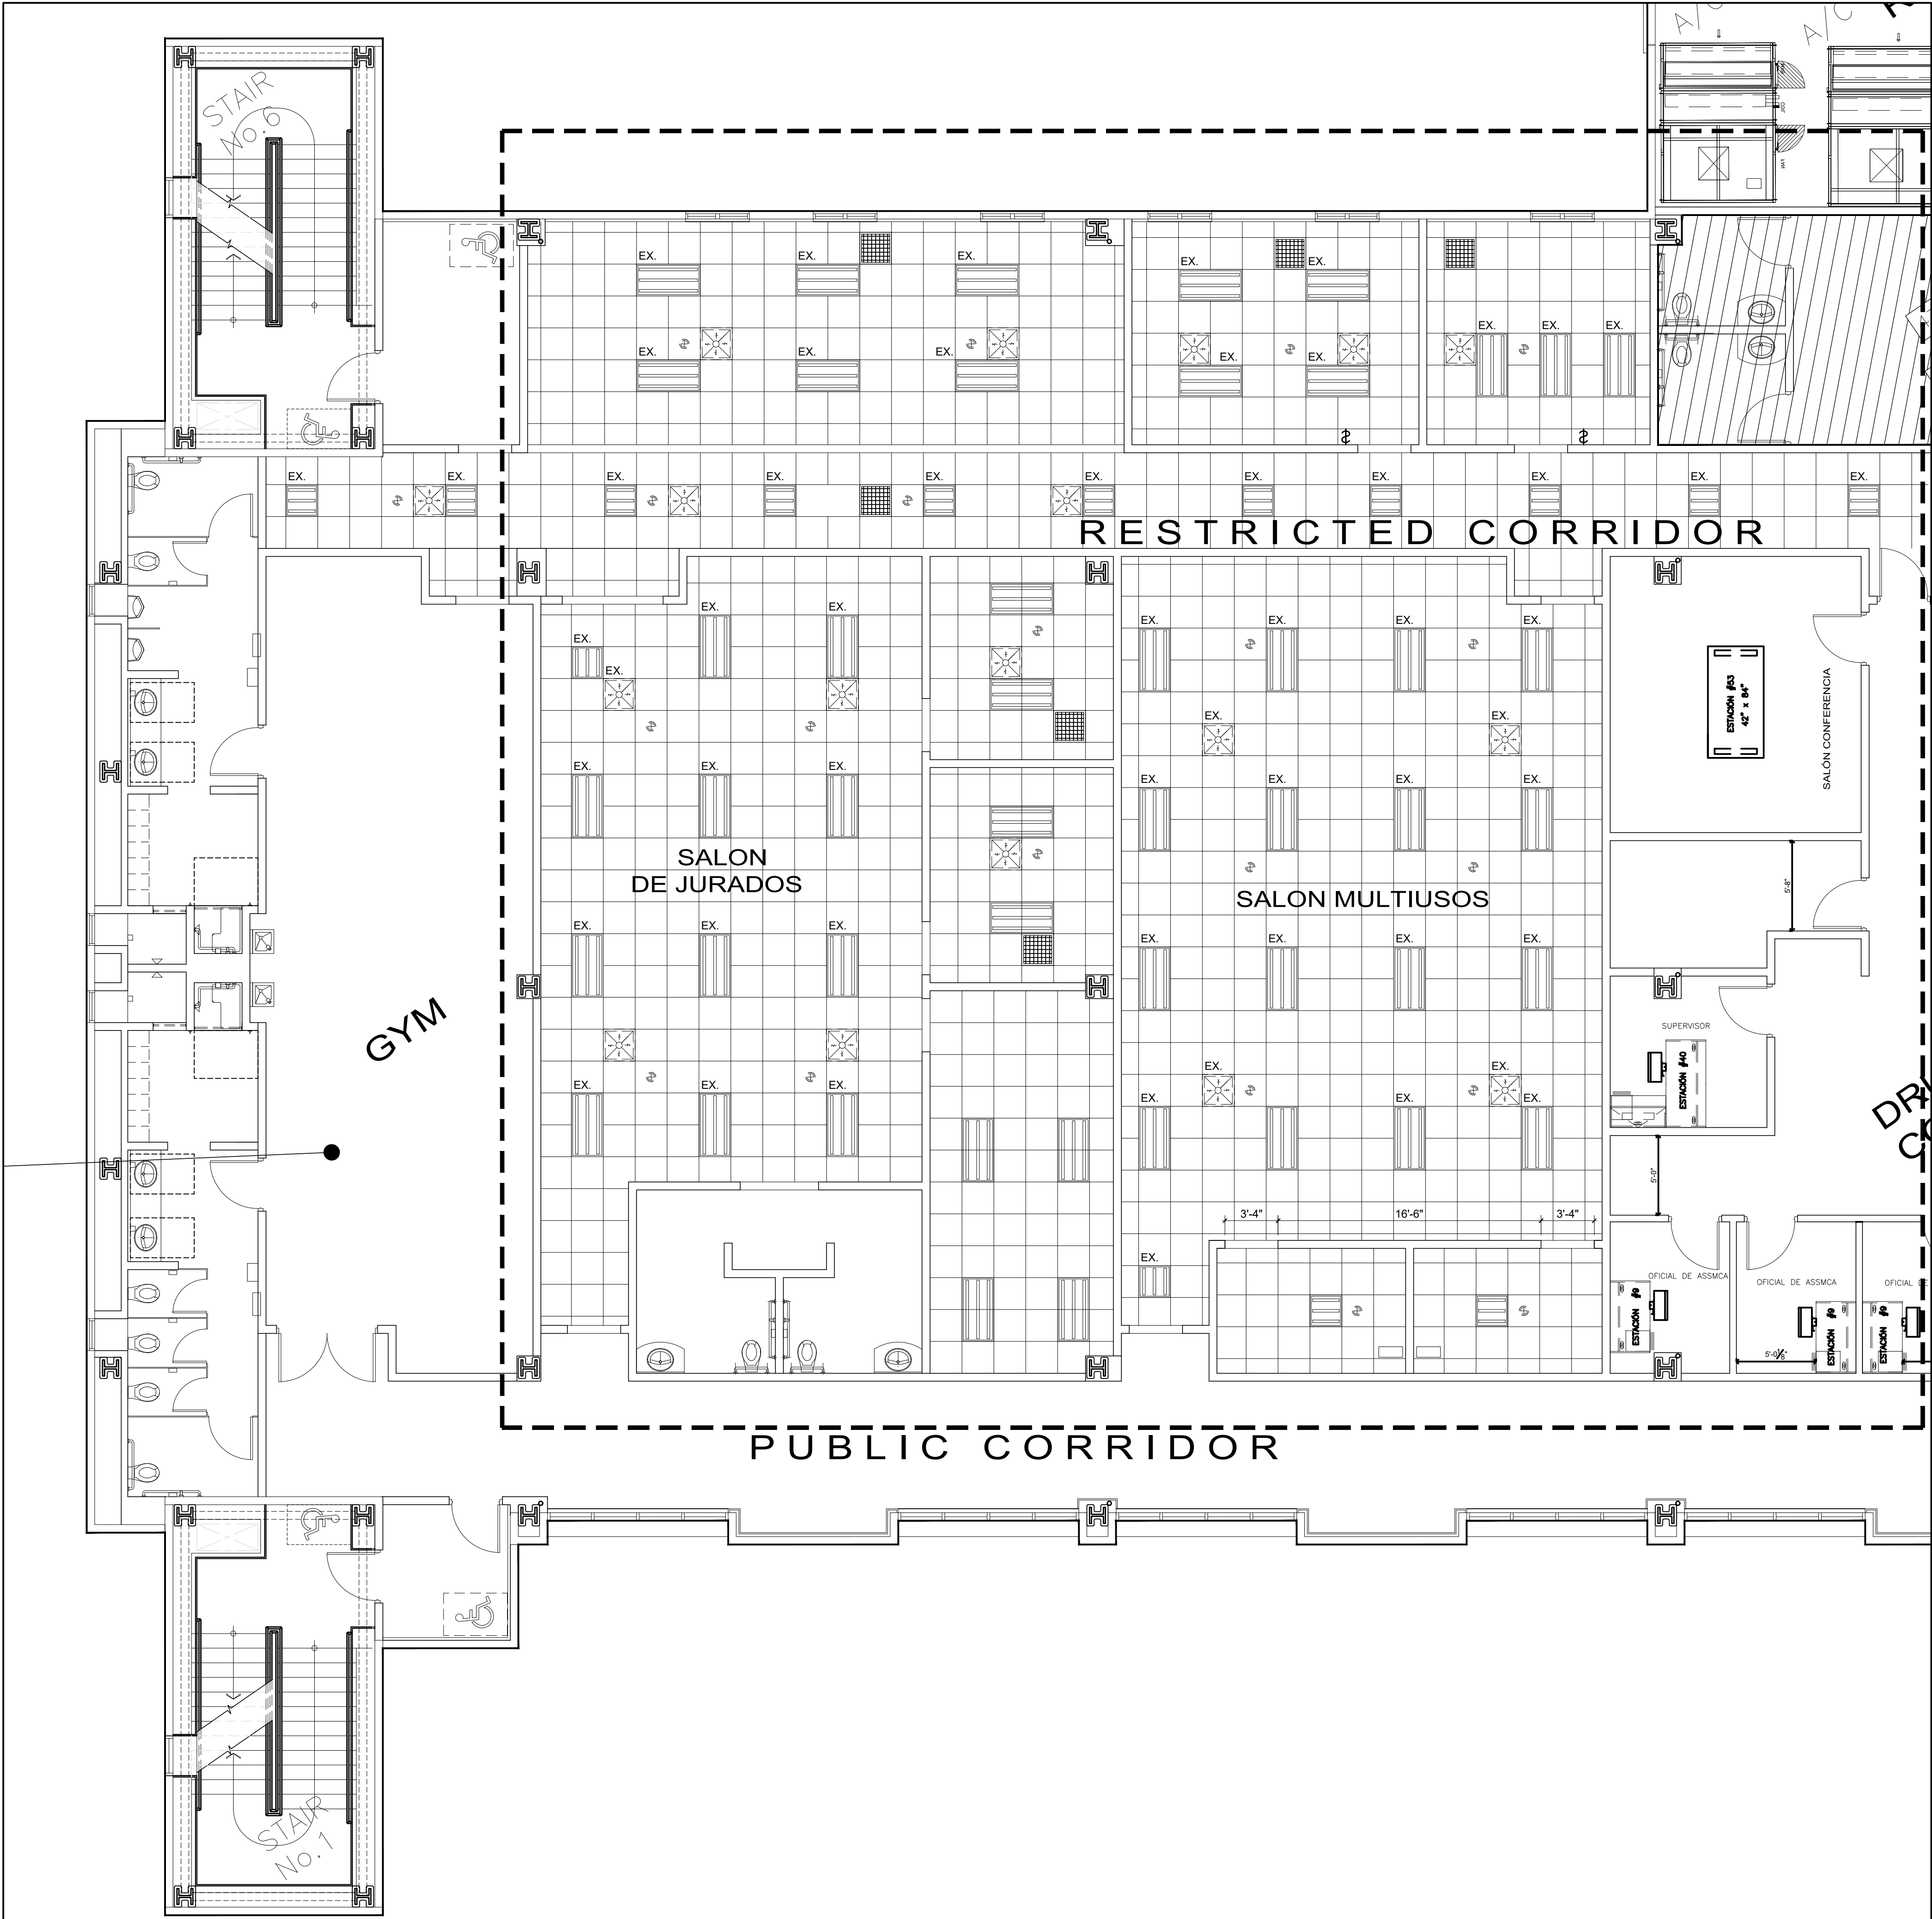

LEGEND:

-
-
-
-
-
-
-
-
-
-
-
-
-
-

- NOTES:
1. SHALL BE USE EMT TUBING, MINIMUM SIZE 3/4"Ø.
 2. ALL SWITCHES AND COVER SHALL BE WHITE COLOR.
 3. ALL LIGHTING CIRCUITS SHALL BE CONNECTED TO AN EXISTING LIGHTING CIRCUITS.
 4. UNDER ANY CIRCUMSTANCE SHOULD BE REMOVED OR CONNECT AN ENERGIZED ELECTRICAL SYSTEM. ALL SOURCE OF POWER SHALL BE TURNED OFF AND LOCK OUT DURING WORKING TIME FRAME.

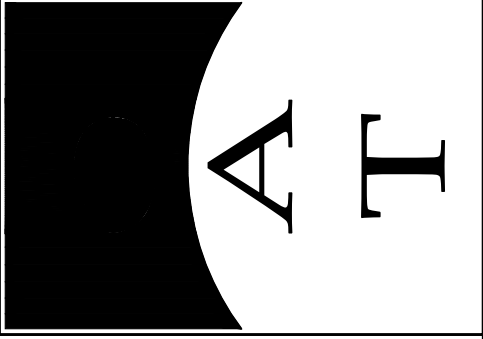

R E V I S I O N S			
NO.	DESCRIPTION	DATE	BY

TRIBUNAL GENERAL DE JUSTICIA

OFICINA DE ADMINISTRACION DE LOS TRIBUNALES

DIRECTORIA DE ADMINISTRACION

OFICINA DE ADMINISTRACION Y CONSERVACION DE LOCALES

APPROVED BY: _____

APPROVED SIGN: _____

APPROVED DATE: _____

PROJECT NAME:	CENTRO JUDICIAL CAGUAS
PROJECT LOCATION:	4 to. PISO DEL CENTRO JUDICIAL DE CAGUAS
DRAWING DESCRIPTION:	PLANTA DE TÍCHO REFLEJADO EXISTENTE
SHEET NO.	70
PROJECT DATE:	OSCAR HERNANDEZ
DRAWING DATE:	DANIEL PAJILLA
DRAWING SCALE:	P. MORALES
FILE NAME:	FEBRERO-2024
OF:	1/4"=1'-0"