


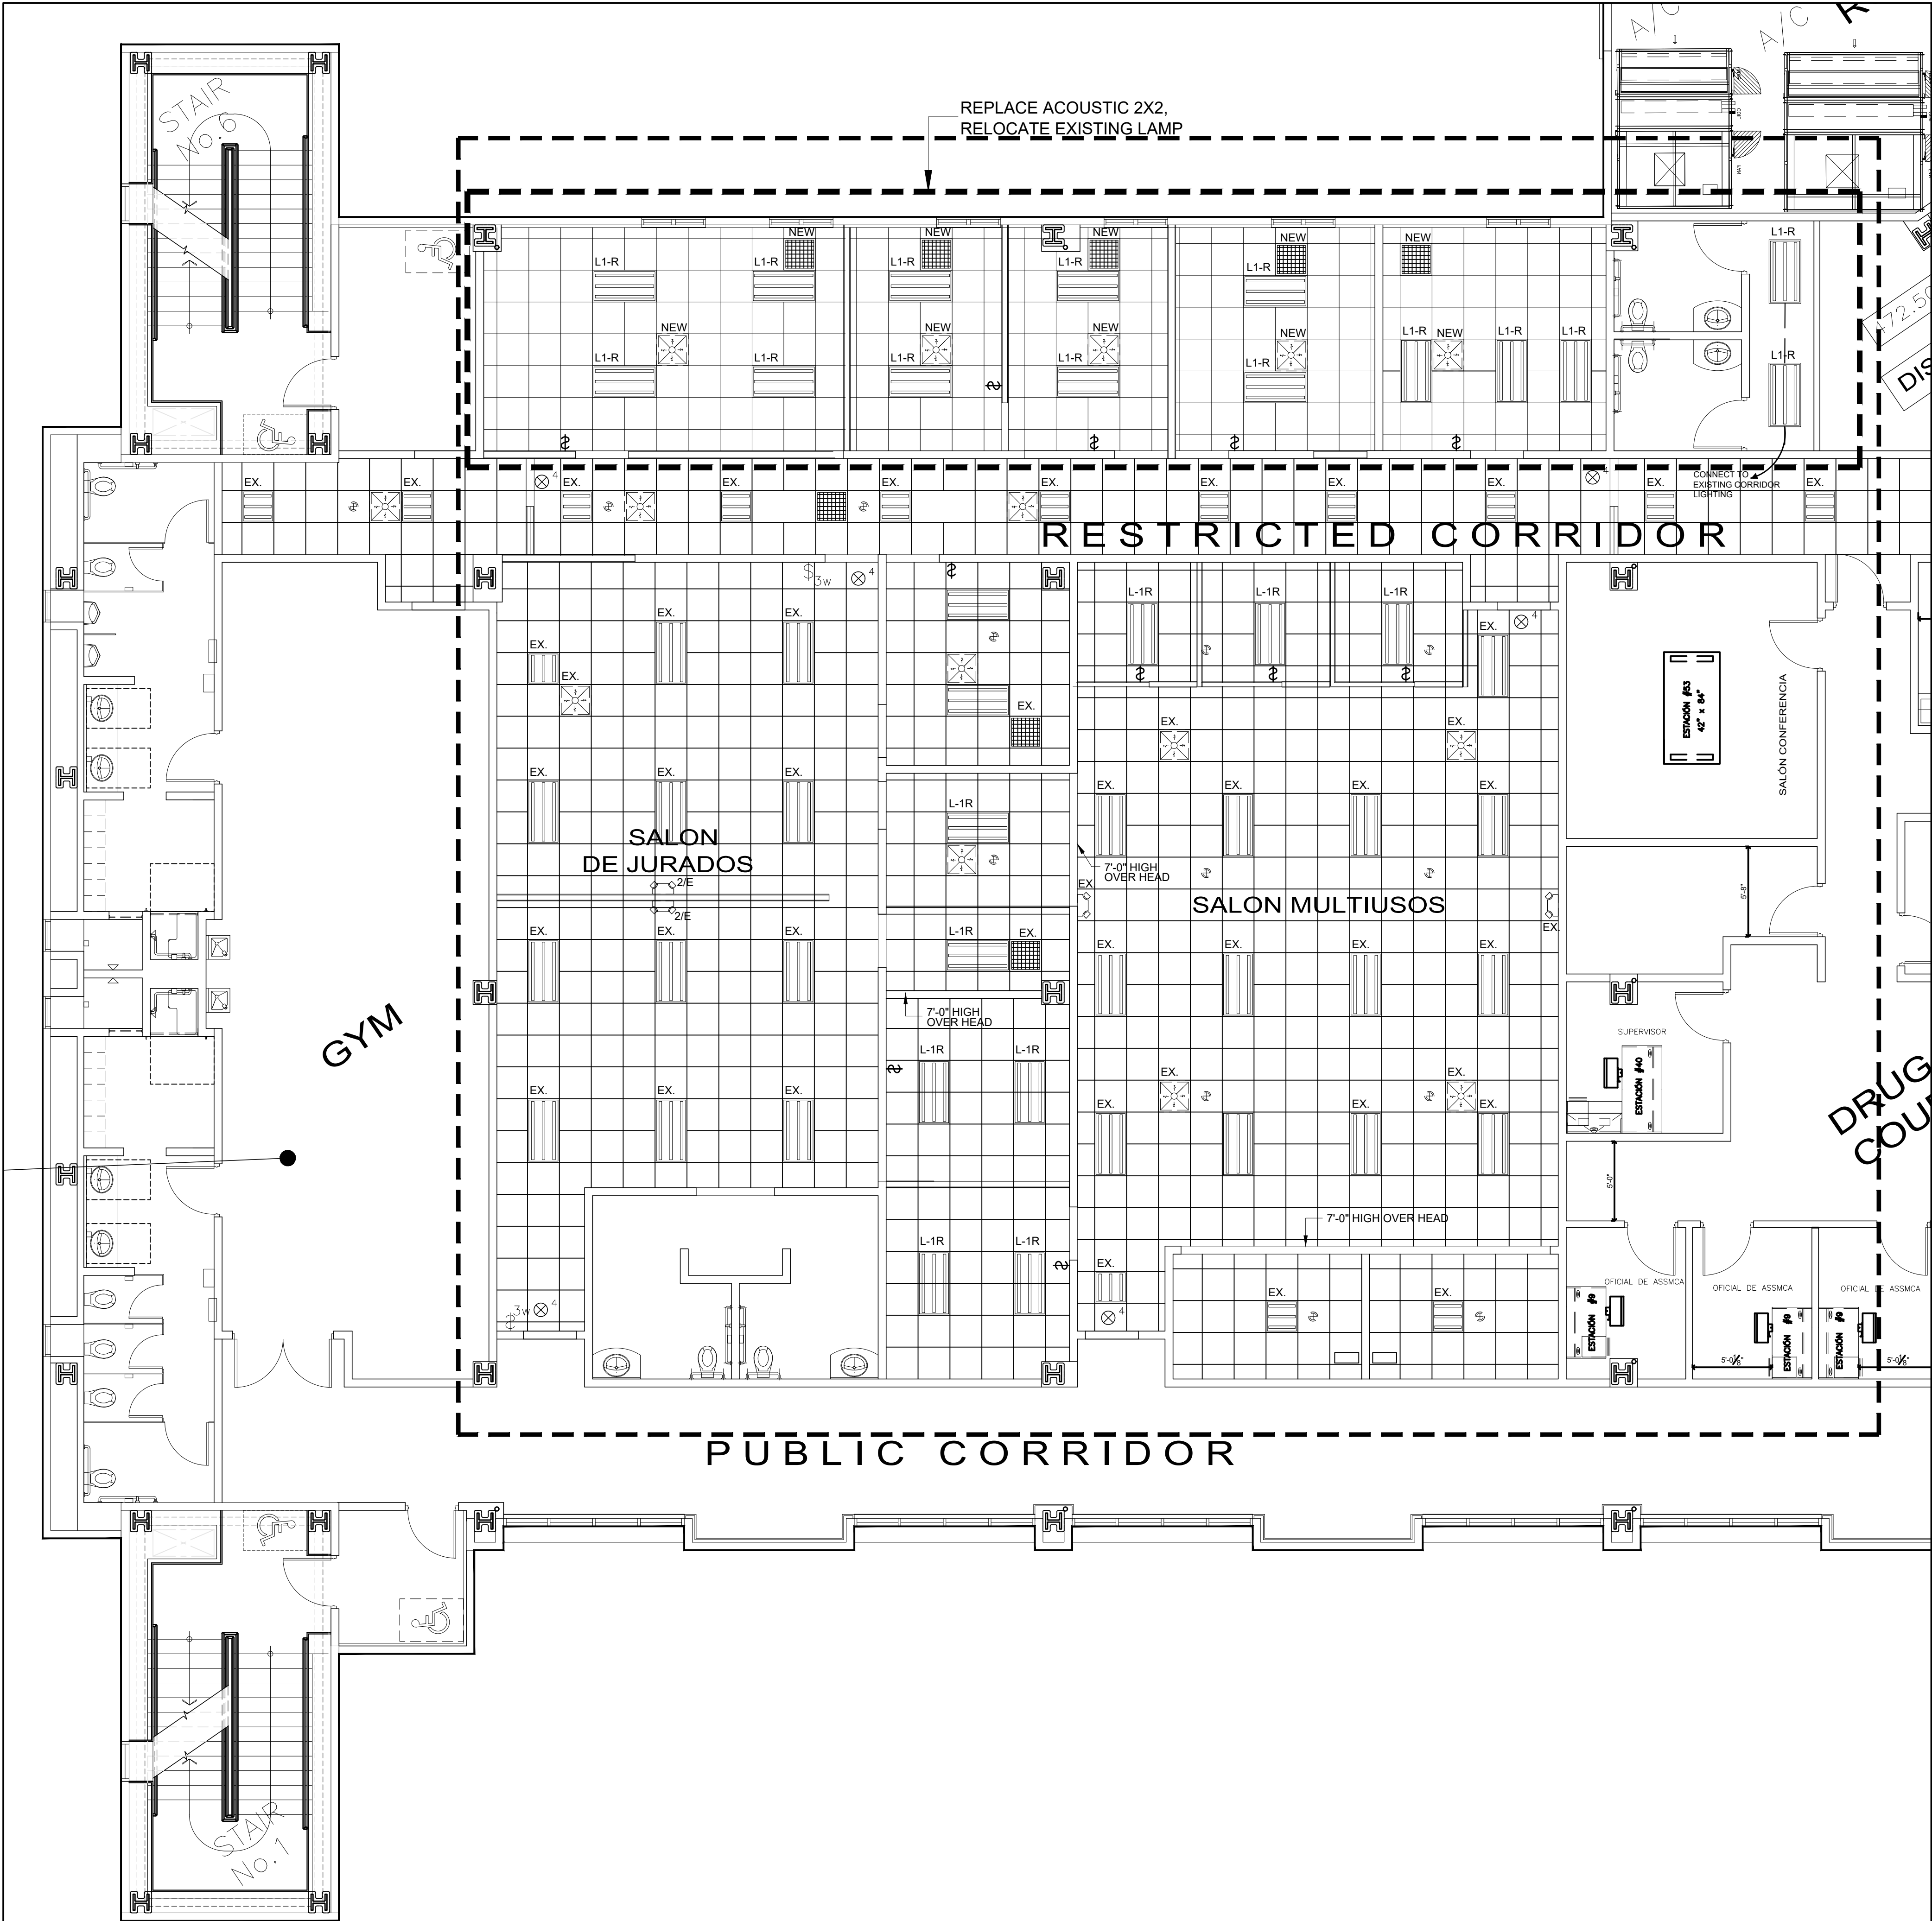


LEGEND:

- 2'-0"x2'-0" EXISTING ACOUSTICAL HUNG CEILING
- 2'-0"x4'-0" RELOCATED LIGHTING FIXTURE. SEE ELECTRICAL DRAWING.
- 2'-0"x4'-0" EXISTING LIGHTING FIXTURE. SEE ELECTRICAL DRAWING.
- NEW LIGHTING CIRCUIT, SHALL BE USED #12 AWG IN 3/4" EMT NEW LIGHTING FIXTURE.
- EXISTING A/C 2'x2' RETURN.
- NEW A/C 2'x2' RETURN.
- EXISTING A/C 2'x2' SUPPLY.
- NEW A/C 2'x2' SUPPLY.
- EXISTING SPRINKLER
- EXISTING EMERGENCY LIGHT TO REMAIN.
- NEW TWO LED - LIGHT, WHITE EMERGENCY EXIT FIXTURE, WITH BATTERY BACKUP OF 60 MINUTES RUN TIME OR MORE, RATED UL 924, UL DAMP LOCATION AND NFPA 101, 120/277V, TO BE INSTALLED & CONNECTED TO THE NEAREST LIGHTING CIRCUIT, BELOW THE CEILING.
- NEW 20 AMP, THREE WAY WHITE COMMERCIAL GRADE SWITCH, TO BE INSTALLED @ 4' A.F.F. NUMBER INDICATES LUMINARIES TO BE CONTROLLED.
- NEW 20 AMP, SINGLE WHITE COMMERCIAL GRADE SWITCH, TO BE INSTALLED @ 4' A.F.F. NUMBER INDICATES LUMINARIES TO BE CONTROLLED.
- EXISTING SINGLE SWITCH TO BE REPLACE, WITH NEW 20AMP WHITE COMMERCIAL GRADE SWITCH. LIGHTING CONTROL CIRCUIT SHALL BE REUSED. NUMBER INDICATES LUMINARIES TO BE CONTROLLED.

NOTES:

- SHALL BE USE EMT TUBING, MINIMUM SIZE 3/4"Ø.
- ALL SWITCHES AND COVER SHALL BE WHITE COLOR.
- ALL LIGHTING CIRCUITS SHALL BE CONNECTED TO AN EXISTING LIGHTING CIRCUITS.
- UNDER ANY CIRCUMSTANCE SHOULD BE REMOVED OR CONNECT AN ENERGIZED ELECTRICAL SYSTEM. ALL SOURCE OF POWER SHALL BE TURNED OFF AND LOCK OUT DURING WORKING TIME FRAME.

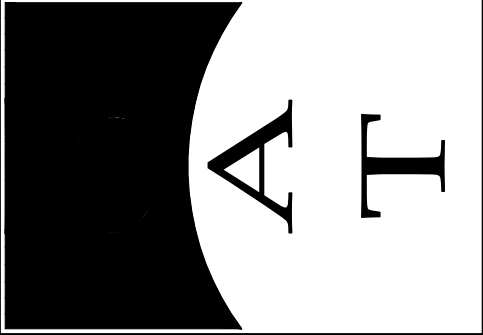

R E V I S I O N S			
NO.	DESCRIPTION	DATE	BY

TRIBUNAL GENERAL DE JUSTICIA
OFICINA DE ADMINISTRACION DE LOS TRIBUNALES
DIRECTORIA DE ADMINISTRACION
OFICINA DE ADMINISTRACION Y CONSERVACION DE LOCALES

APPROVED BY: _____
APPROVED SIGN: _____

APPROVED DATE: _____

PROJECT NAME: CENTRO JUDICIAL CAGUAS	GERENTE DE PROYECTO: OSCAR HERNANDEZ	PROJECT DATE: FEBRERO-2024	FILE NAME: A-2.1
PROJECT LOCATION: 4 to. PISO DEL CENTRO JUDICIAL DE CAGUAS	PROYECTO EN ALMANCE: CAGUAS	PRINTING DATE: FEBRERO-2024	OF: 09
PLANTA DE TÍCHO REFLEJADO PROPUUESTO	DRAWING BY: DANIEL PAVILLA	SHEET: 20	
	P. MORALES		