

















REVISIONS	
NO.	DESCRIPTION

TRIBUNAL GENERAL DE JUSTICIA
 OFICINA DE ADMINISTRACION DE LOS TRIBUNALES
 DIRECTORIA DE ADMINISTRACION Y CONSERVACION DE LOCALES







APPROVED BY: _____ APPROVED DATE: _____
 APPROVED SIGN: _____


PROJECT NAME: REMODELACION DE OFICINAS Y SALON DE REUNIONES EJECUTIVAS
 PROJECT LOCATION: PISO # 22 EDIFICIO WORLD PLAZA
 DRAWING DESCRIPTIONS: PLANTA ELECTRICA (POWER)
 SHEET NO.: _____
 GERENTE DE PROYECTO: OSCAR HERNANDEZ
 CHECKED BY: PABULLA
 DRAWING BY: P. MORALES
 FILE NAME: _____
 FEBRERO-2024
 AS SHOWN

LEGEND:

-  -DUPLEX RECEPTACLE @ 1'-6" A.F.F.
-  -DUPLEX RECEPTACLE EXISTING @ 1'-6" A.F.F.
-  -DUPLEX RECEPTACLE @ 7'-0" A.F.F.
-  -DUPLEX RECEPTACLE ISOLETED GROUND @ 1'-6" A.F.F. (Orange Color).
-  -POWER POLE : (UN CIRCUITO DEDICADO), (UN CIRCUITO COMUN).
-  -SMOKE DETECTOR.
-  -PANIC BUTTOM. (Installed in discreet location).
-  -REMOTE RELEASE LOCK BUTTOM, FOR SECURITY DOOR.
-  -TELEPHONE JACK OUTLET.
-  -COMPUTER LAN CONNECTION.
-  -COAXIAL CABLE JACK OUTLET.
-  -MICROPHONE JACK PLUG AT FINISH FLOOR.
-  -SECURITY TV CAMARA AT WALL OR CEILING.
-  -SPEARKER SYSTEM AT CEILING.
-  -SPEARKER HORN, STROBE AT CEILING.
-  -EXIT SIGN.
-  -NEW OR RELOCATED A/C 2'x2' SUPPLY.
-  -EXISTING A/C 2'x2' SUPPLY.
-  -EXHAUST FAN.
-  -ELECTRICAL BREAKER PANEL.
-  -NEW A/C 2'x2' RETURN.
-  -JUNCTION BOX @ 7'-0" FINISH FLOOR
-  -PANEL ELÉCTRICO

LEGEND:

-  2'-0'x2'-0" ACOUSTICAL HUNG CEILING
-  2'-0'x2'-0" LIGHTING FIXTURE. SEE ELECTRICAL DRAWING.
-  2'-0'x2'-0" LIGHTING FIXTURE. EMERGENCY
-  3" SPOT L.E.D. LIGHT FIXTURE
-  EXIT LIGHTING FIXTURE.
-  CAMERA CONNECTION OVER CEILING

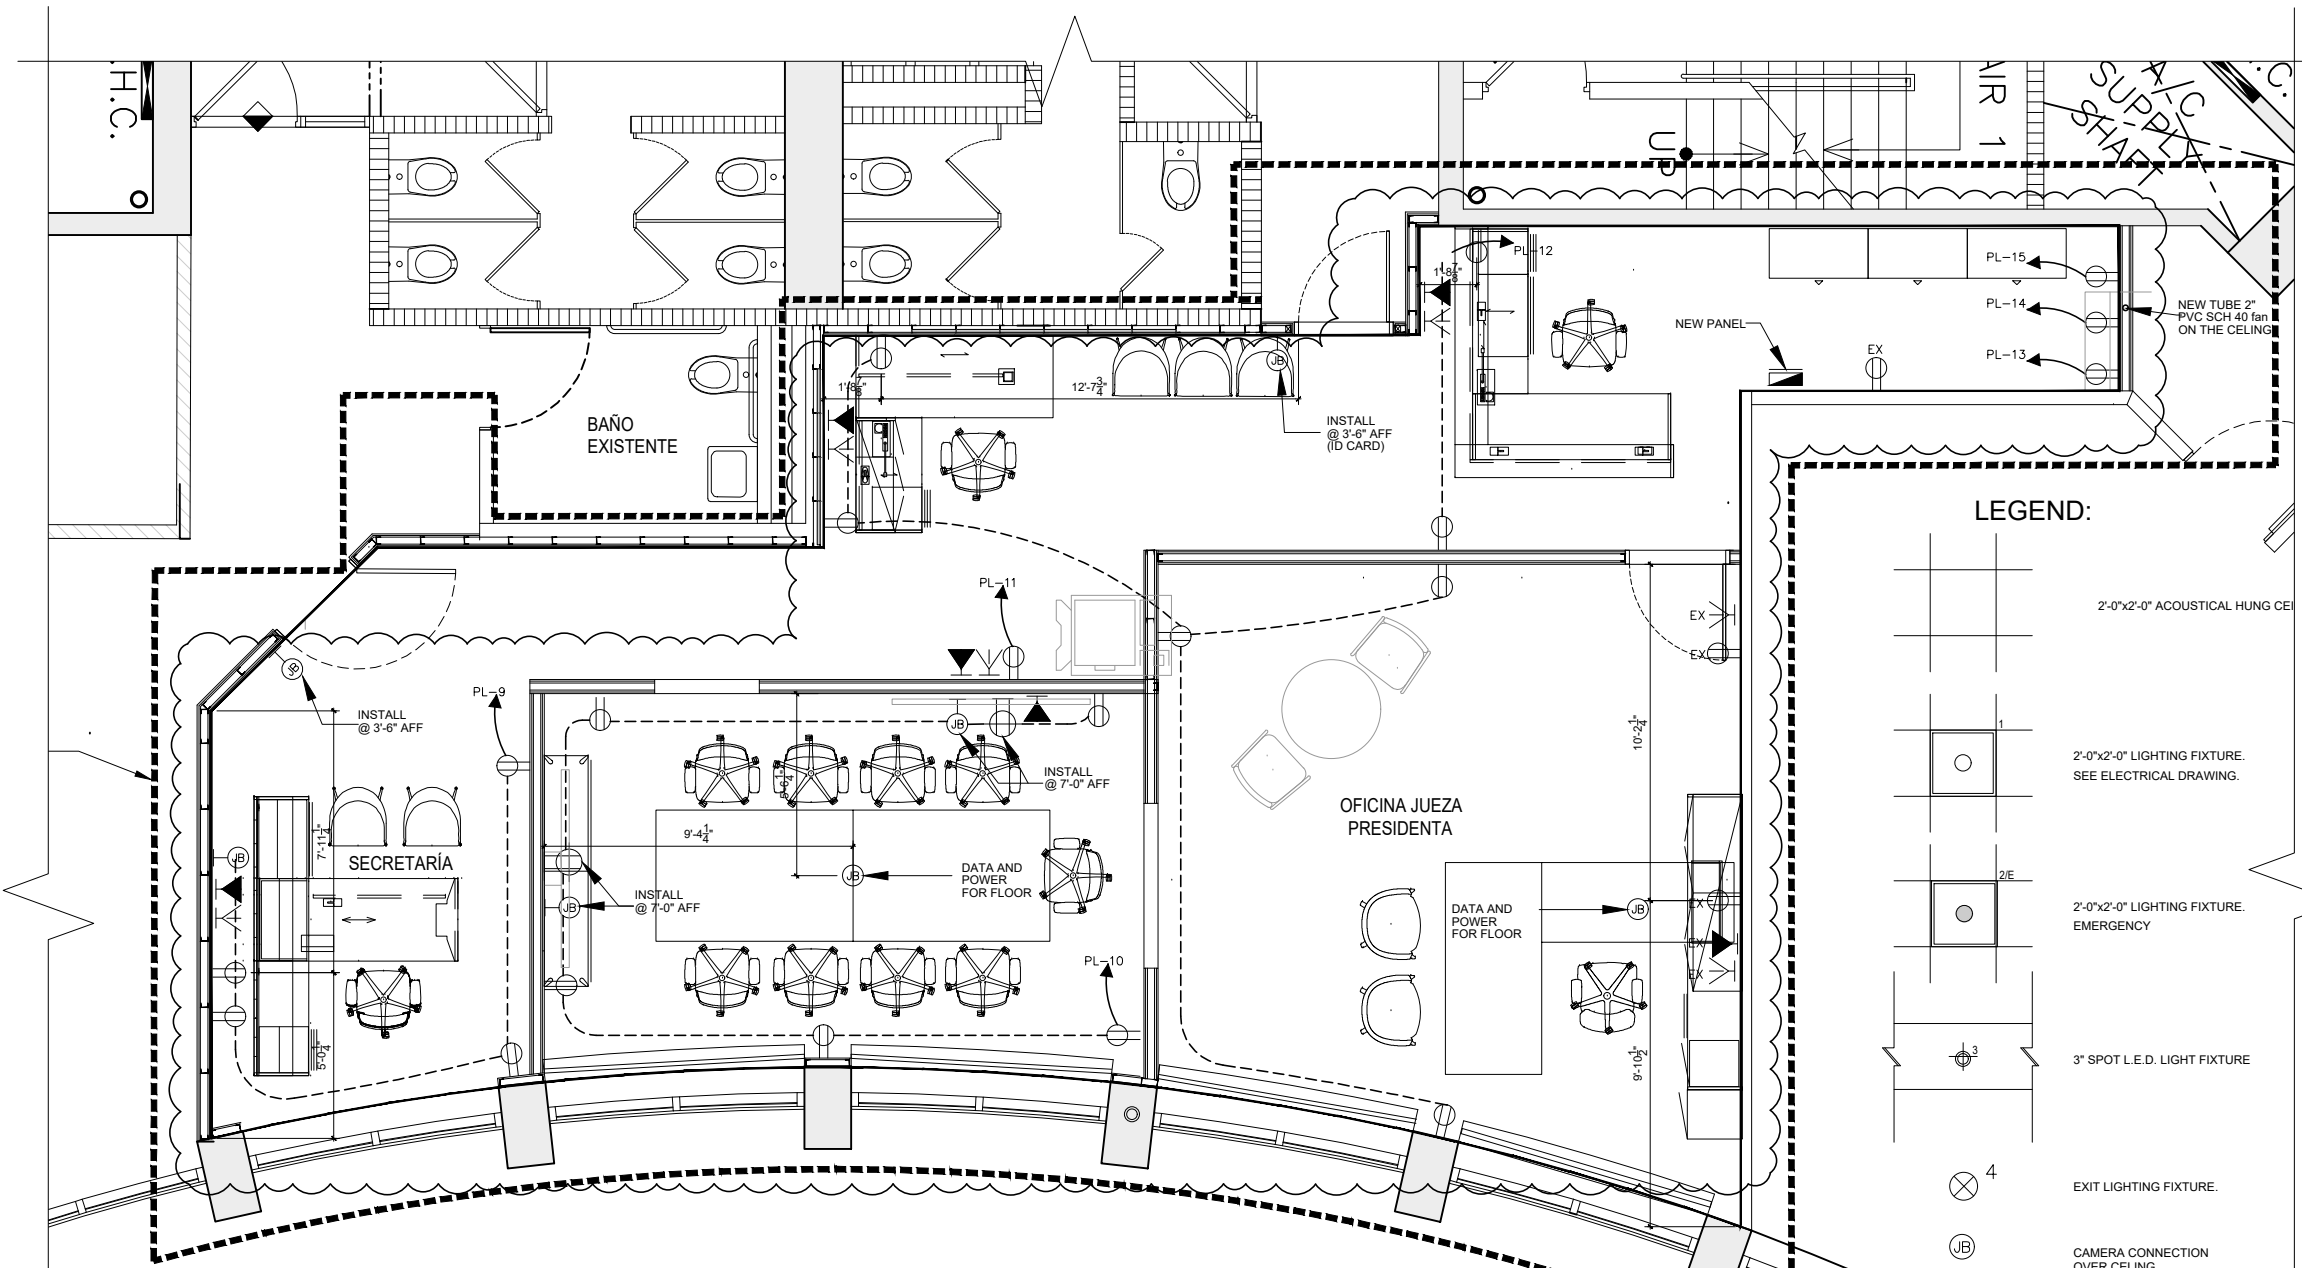

PLANTA ELECTRICA (POWER)
 scale: 3/8" = 1'-0"

NOTAS:

1. UTILIZAR TUBERÍA 3/4"Ø EMT.
2. RECEPTÁCULOS Y TAPAS A UTILIZARSE COLOR BLANCO.
3. LOS CIRCUITOS SE CONECTARÁN EN EL PANEL NUEVO A INSTALARSE.
4. PANEL A INSTALARSE MODELO PBT GE TL12412C INDOOR NEMA 1 ENCLOSURE.

NOTE:
 1. EN PUERTA (1) (3) DEJAR INFRAESTRUCTA PARA CAMARA DE SEGURIDAD Y TARGETA DE SEGURIDAD (CARD READING)